


# Meter Pole Requirements for Central Al. Electric Cooperative

## Pole Must be 20' Long, Treated, & 6"x6" Sq. or 6" Round

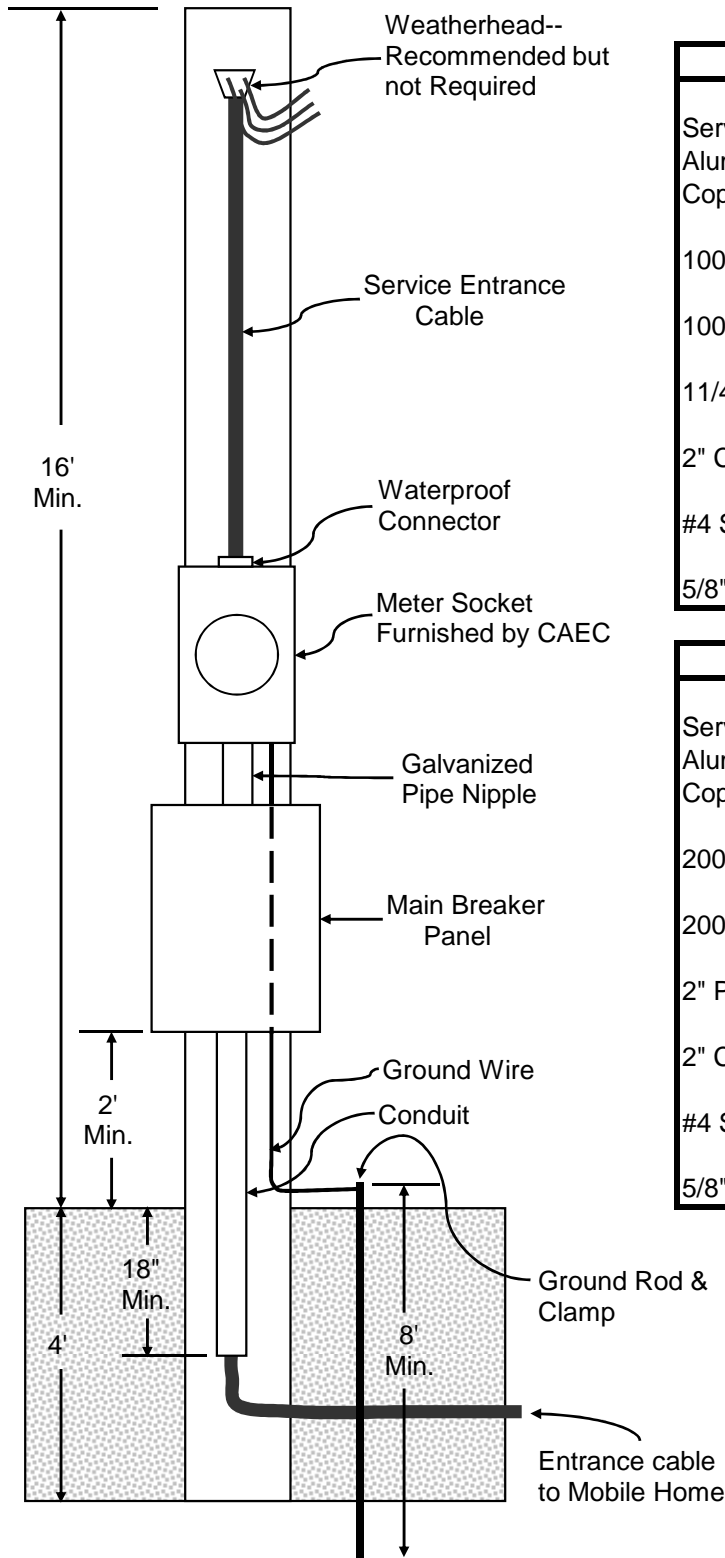

### Materials Required

100 AMP
Service Entrance Cable Sizes Aluminum---#2 Copper--#4
100 AMP Meter Socket
100 AMP Main Breaker Panel
1 1/4" Pipe Nipple
2" Conduit
#4 Solid Bare Copper Ground Wire
5/8"x8' Galvanized or Copper Ground Rod

200 AMP
Service Entrance Cable Sizes Aluminum---#4/0 Copper--#2/0
200 AMP Meter Socket
200 AMP Main Breaker Panel
2" Pipe Nipple
2" Conduit
#4 Solid Bare Copper Ground Wire
5/8"x8' Galvanized or Copper Ground Rod

Schedule appointment with staking engineer for location of meter pole before installing